

# Preparation unit—Accessories

AIRTAC

## DPH Series digital display pressure sensor(Aalog output)




### Specification

Model	DPHN2(3)(B)-01 / DPHP2(3)(B)-01 / DPHN2(3)(B)-10 / DPHP2(3)(B)-10
Input power	Voltage 12~24 VDC ± 10% Ripple(p-p) < 10% Current Consumption 40mA or less
	Fluid Non-corrosive gas
Pressure range	Measurement range DPHN2(3)(B)-01/DPHP2(3)(B)-01 : -15psi~15psi DPHN2(3)(B)-01/DPHP2(3)(B)-10 : -15psi~150psi
	Withstand pressure DPHN2(3)(B)-01/DPHP2(3)(B)-01 : -15psi~22psi DPHN2(3)(B)-01/DPHP2(3)(B)-10 : -15psi~175psi
	Measurement error ±2% F.S. , ±1digit(Temperature:25±3°C)
	Repetitive accuracy ±0.2% F.S.
	Temperature error ±3% F.S.(Base 25°C , Range 0 to 50°C)
Display	Type 4-digit measurement, 3.5-digit setting Output LCD Analog and Double row LCD display Color 2-color LCD (Red/Green)
	Output model Basic mode, Hysteresis mode, Window comparator mode Suction check mode, Leakage mode
Switch Output	Transistor output NPN:Maximum applied voltage 30V/100mA,Retained voltage <2V PNP:Maximum applied voltage 30V/100mA,Retained voltage <2V
	Analog Voltage Output 1 to 5V±3% F.S. (Minimum load impedance 1kΩ)
	Analog Current Output 4 to 20mA±3% F.S.(Range of Load impedance is 50 ~ 260Ω)
	Output-delay time 2ms, 20ms, 100ms, 500ms, 1000ms, 2000ms
Pressure Unit	DPHN2(3)(B)-01 DPHP2(3)(B)-01 kPa, kgf/cm², bar, psi, mmHg, inHg DPHN2(3)(B)-10 DPHP2(3)(B)-10 MPa, kPa, kgf/cm², bar, psi, cmHg, inHg
	Vibration resistance 10 to 500Hz with 10mm Amplitude in X, Y, Z directions for 2hrs
	Impact resistance Maximum 100m/s² , X, Y, Z directions 3 times each
	Operating Temp. range 0~50°C
	Stored Temp. range -20~65°C
	Humidity range 35%~80% RH(No condensation)

### Symbol



### On-line Manual

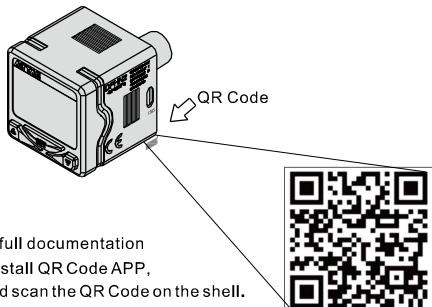

Get full documentation

1. Install QR Code APP, and scan the QR Code on the shell.
2. Documentation website, <http://www.airtac.net/OM/main.htm>.

### Ordering code

DPH N2 □ - 01 020 □


① ② ③ ④ ⑤ ⑥

① Model	② Output type	③ Electrical entry	④ Measurement range	⑤ Lead wire length	⑥ Piping specifications
DPH: Digital Display Pressure Sensor (Analog output)	N2: NPN+Analog voltage output(1-5V) P2: PNP+Analog voltage output(1-5V) N3: NPN+Analog current output(4-20mA) P3: PNP+Analog current output(4-20mA)	Space: Terminal B: Grommet [Note]	01: -100kPa~100kPa 10: -100kPa~1,000kPa	020: Length 2m 030: Length 3m 050: Length 5m	Blank: PT1/8 with M5 female thread T: NPT1/8 with 10-32UNF female thread G: G1/8 with M5 female thread


[Note] The safety grade of grommet type is IP63.

### Dimensions

#### Terminal

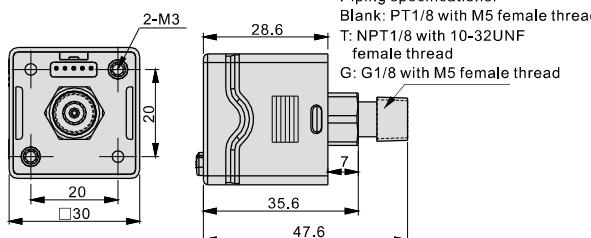

#### Grommet

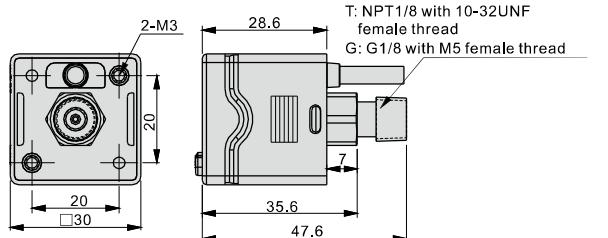


# Preparation unit—Accessories

AIRTAAC

## DPH Series digital display pressure sensor(Aalog output)


### User interface Instruction

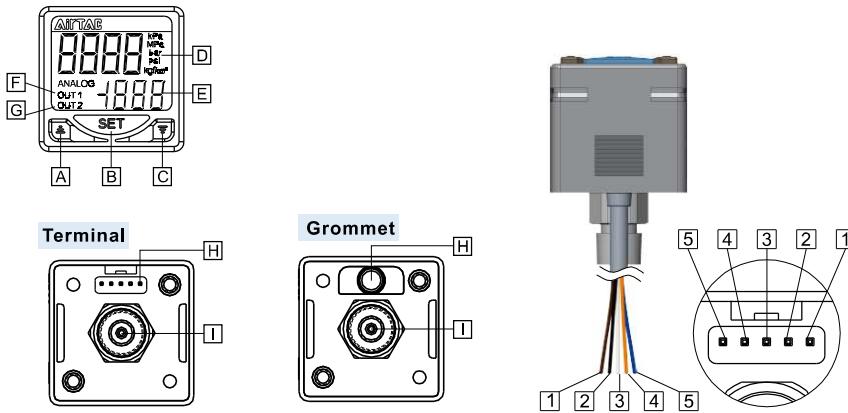


No.	Item
A	Value up button
B	Setting button
C	Value Down button
D	Pressure display area
E	Set pressure display area
F	Output 1 indicator light
G	Output 2 indicator light
H	Power and signal connector
I	Pressure input
1	DC(+) input (Brown)
2	OUT1 (Black)
3	OUT2 (White)
4	Analog/Zero (Orange)
5	DC(-) input (Blue)

### Connection Example


#### NPN Output

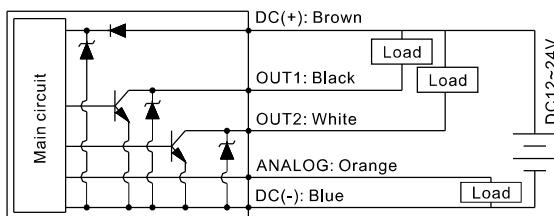

#### Zero-shift Input

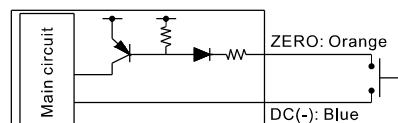


#### PNP Output

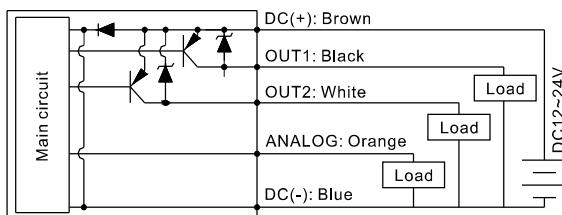

### User Interface Instructions

#### 1. Mode switch

Install the connector  
Turn on the power



#### (Basic mode)




Press the SET button  
for two seconds

Interface switch

Press the SET button  
for two seconds

#### (Measurement mode)




Press the SET button  
for four seconds

Interface switch

Press the SET button  
for two seconds

#### (Display Zero-shift Pressure)




# Preparation unit—Accessories

AIRTAAC


## DPH Series digital display pressure sensor(Aalog output)

### 2. Measurement mode




Press the SET button  
to change menu

#### Interface of Basic mode

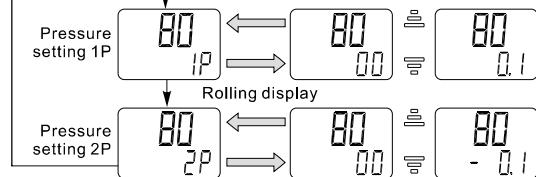


Press the value up and down  
button to set the pressure value



#### Interface of Hysteresis mode

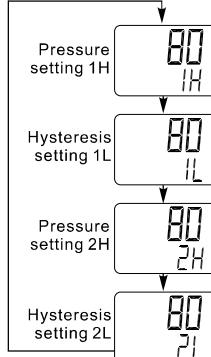


#### Interface of Window mode

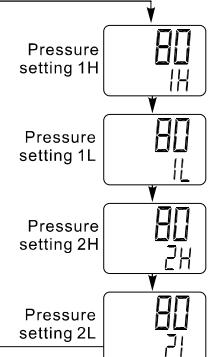

#### Interface of Suction check mode

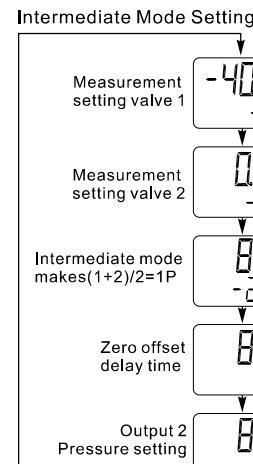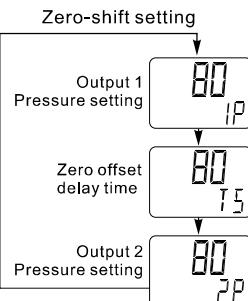

#### Interface of Leak mode




# Preparation unit—Accessories

AIRTAAC

## DPH Series digital display pressure sensor(Acyclic output)

### 3. Basic mode


Interface of Basic mode

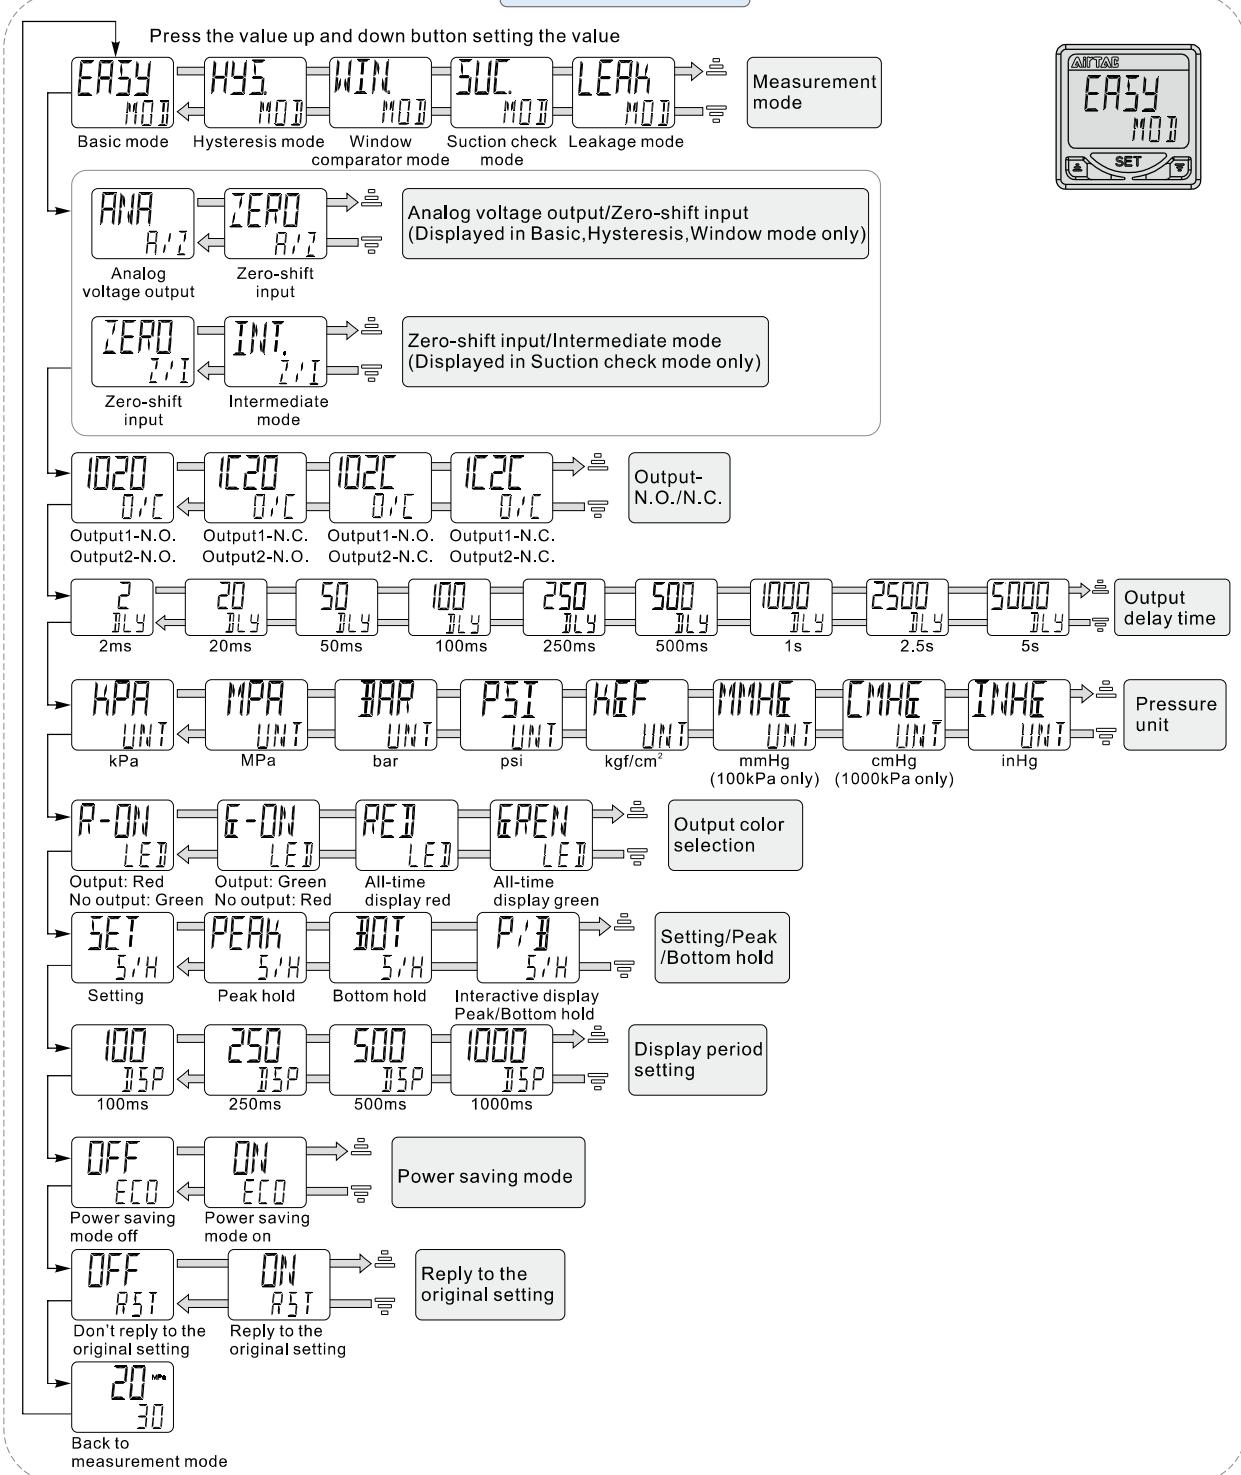


## DPH Series digital display pressure sensor(Analog output)

### Output mode description


1. Basic mode: Set the pressure value 1P/2P. When the applied pressure value is greater than 1P/2P + hysteresis value, the display will ON. When the applied pressure value is less than P + hysteresis value, the display will OFF.

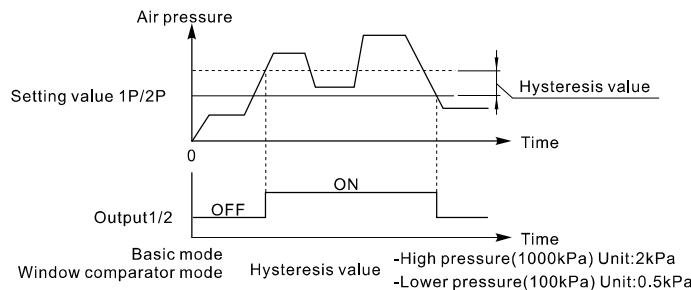

2. Hysteresis mode: Set the pressure value 1H/2H/1L/2L. When the applied pressure value is greater than 1H/2H, the display will ON. When the applied pressure is less than 1L/2L, the display will OFF.

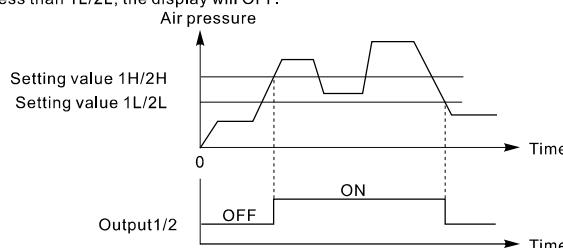

3. Window comparator mode: Set the pressure value H/L. When the pressure is greater than the H value or less than the L value, the output is OFF; when the air pressure is greater than the L value and less than the H value, the output is ON.

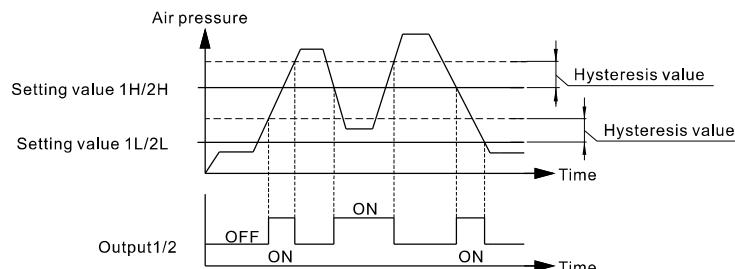


4. Suction check mode: Generally used for suction check detection applications. After the zero-shift signal is triggered, the zero-shift is completed after the TS time.

- TS: Zero-shift delay time.
- 1P: "Pressure" setting value of output 1 before zero-shift (or without zero-shift).
- 1P': Output 1 after zero-shift. Relative to the reference value of the suction starting point pressure (zero offset point).
- 2P: Pressure setting of output 2.

◇ Output 1: Suction pressure detection,  
In (N.O.) mode, the output 1 is ON when the measured pressure value is less than the setting value 1P (1P');  
Without zero-shift input, output 1 ON/OFF judgment based on 1P, which is the suction pressure setting value relative to atmospheric pressure.

With a zero-shift input, output 1 ON/OFF judgment based on 1P', which is the reference setting value with relative to the zero-shift point.  
◇ Output 2: Vacuum plate break detection. In (N.O.) mode, output 2 turns ON when the air pressure is greater than the setting value 2P.

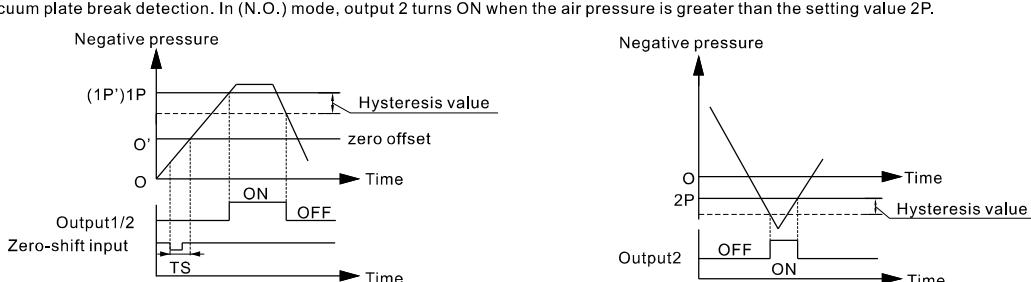

# Preparation unit—Accessories

## DPH Series digital display pressure sensor(Analog output)

### 5. Leakage Mode: Generally used for leak detection applications.


The zero-shift is completed after the zero-shift signal is triggered

◇1H: Output 1 upper limit setting value; 1L: Output 1 lower limit setting value.

◇2P(2P'): Output 2's "Leak" setting (Negative value).


◆Output 1: Fill pressure detection. In the normally mode, output 1 is ON when the pressure is between 1H and 1L

◆Output 2: Leakage detection. when only the zero-shift input, it will make output 2 ON/OFF judgment; In the normal mode, Output 2 is ON. when the leakage is greater than the setting value 2P (2P').

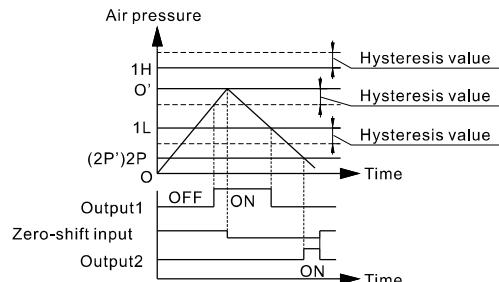

### 6. Analog output


#### 6.1) Analog Voltage Output (1-5V)

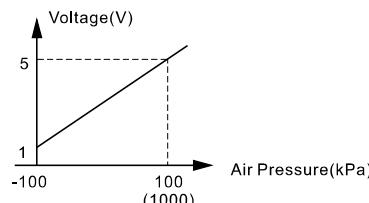

◆In the analog voltage output mode, the orange line should pay attention to the following wiring:

1. Don't directly connect 0V or any bias voltage under no load to avoid internal circuit damage.
2. The minimum load impedance needs to be >1kΩ (Don't float) to avoid distortion of the output voltage.

#### 6.2) Analog Current Output (4-20mA)

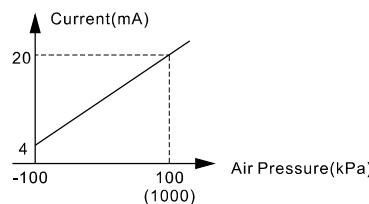

◆In the analog current output mode, the orange line should pay attention to the following wiring:


1. Don't directly connect 0V or any bias voltage under no load to avoid internal circuit damage.
2. The range of load impedance is 50Ω to 260Ω. (Don't float) to avoid distortion of the output current.

### 7. Key lock Function

Lock: Press and the SET button simultaneously. Release it when the display turns to "LCK on".


Unlock: Press and the SET button simultaneously. Release it when the display turns to "LCK OFF".

Press any button will display "LCK" in lock on mode.

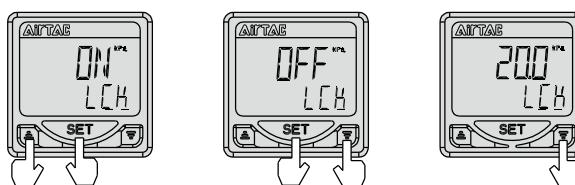

### 8. Zero-Clear Function

Press and simultaneously to reset the display value to zero.



Press and simultaneously.


# Preparation unit—Accessories

## DPH Series digital display pressure sensor(Analog output)

### Dimensions/Assembly Instruction


#### Panel mount adapter + Front protective cover

Order the Installation accessories  
(Ordering code:F-DPSEB,applicable to terminal and gromment type)

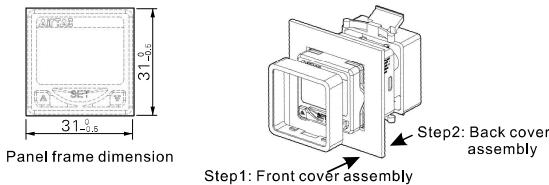


#### Bracket

Order the installation accessories (Ordering code: F-DPSLB)

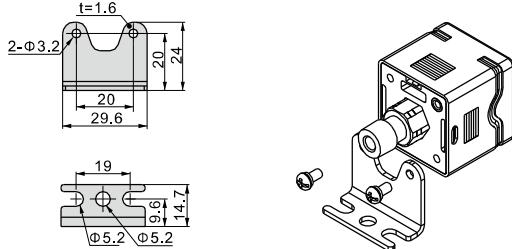

Order the Installation accessories  
(Ordering code:F-DPSDEB,applicable to bottom ported type)

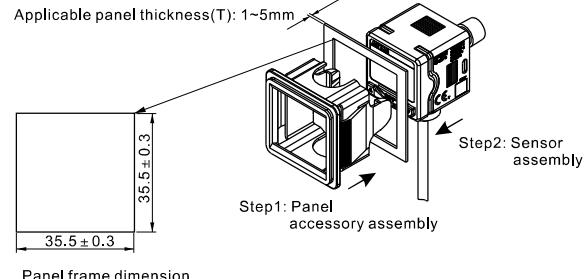

### Notes

1. Do not drop, knock or apply excessive impact while handling. Otherwise could cause damage and a malfunction.
2. The tensile strength of the cord is 60N. Applying a greater pulling force on it can cause a malfunction.
3. Do not exceed the screw-in torque of 7N.m when installing piping. Exceeding this value may cause malfunctioning of the sensor.
4. Do not use it with corrosive and/or flammable gases or liquids.
5. Please use it within rated pressure range.
6. Turn off the power before connecting the wires.
7. Don't use in an environment with spattering liquid of oil or solvent.
8. Separate power lines from high voltage lines, avoiding wiring in the same conduit with these lines.